



EAST CHERRY CREEK VALLEY WATER AND SANITATION DISTRICT
COLORADO, UNITED STATES

EAST CHERRY CREEK VALLEY WATER AND SANITATION DISTRICT

COLORADO, UNITED STATES

- MARKET -

Municipal

- APPLICATION -

Drinking Water

- WATER SOURCE -

Brackish Water

- TECHNOLOGIES -

Brine Minimization
+ RO (Reverse Osmosis)


- HIGHLIGHTS -

Flow rate: 2 x 1,340-1,679 m³/d (2 x 246-308 gpm)

Recovery rate: up to 75%

Reduction of overall reject to environment.

95% combined recovery of the LPRO and HPRO.

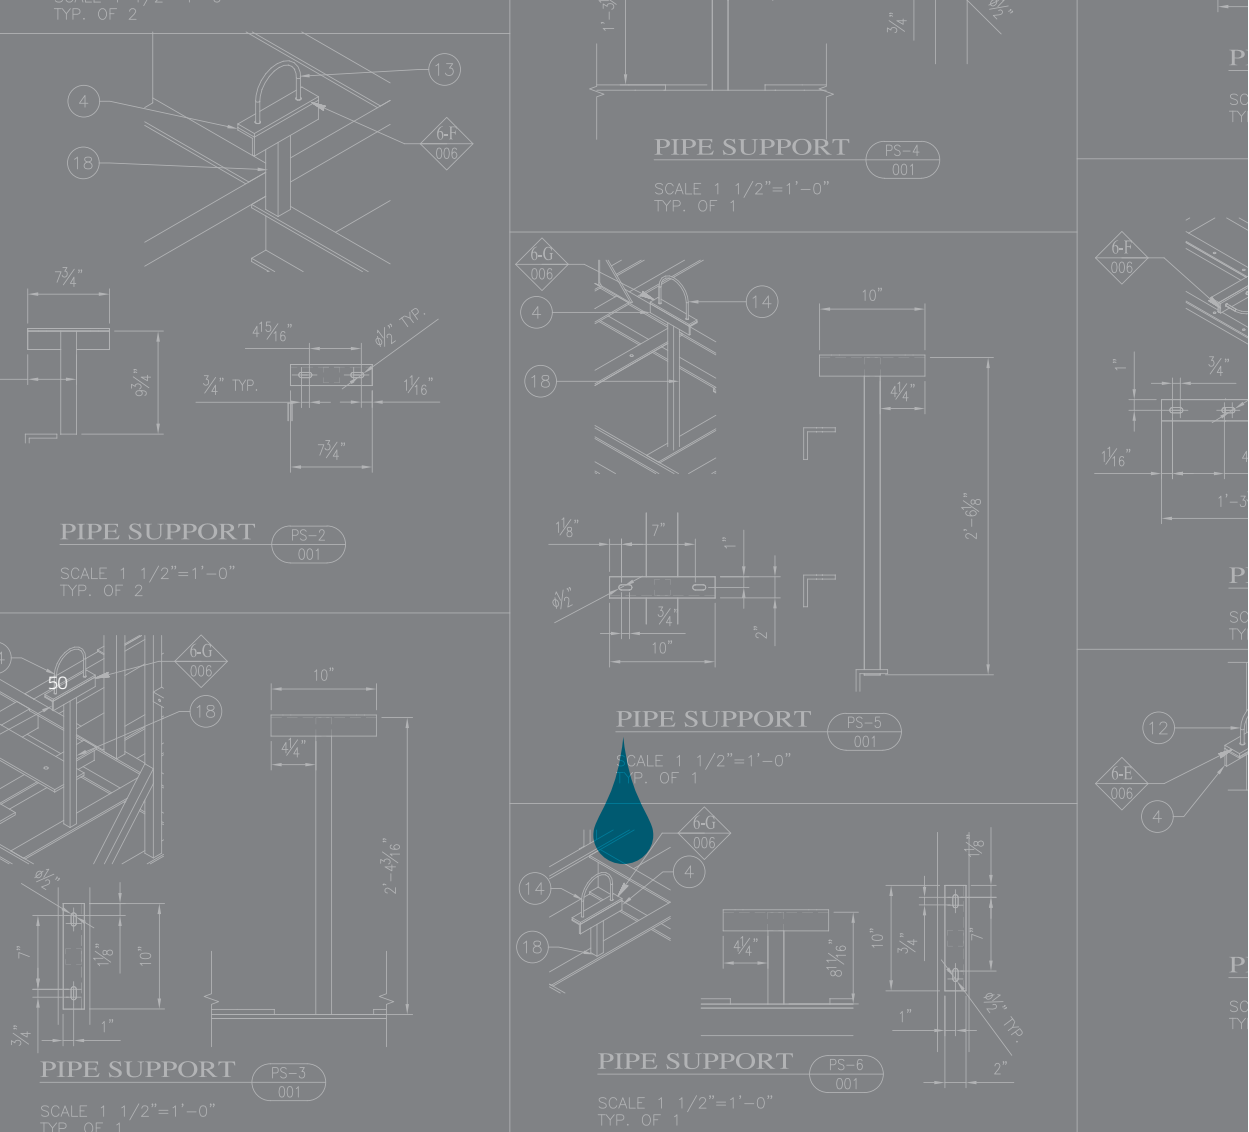

ALL INFORMATION, SPECIFICATIONS AND DATA SHOWN ON THIS PRINT ARE FURNISHED BY AND ARE TO REMAIN THE PROPERTY OF h₂o Innovation. ACCEPTOR WARRANTS THAT NO USE WILL BE MADE OF THIS PRINT EXCEPT TO FACILITATE THE INSTALLATION, MAINTENANCE AND OPERATION OF THE EQUIPMENT IDENTIFIED BY SAID PRINT.

DRAWING REVISION		REVISION DESCRIPTION	DRAWN	CHKD
REV	DATE			
A	08-25-11	PRELIMINARY		
B	09-26-11	REVISED INSTRUMENT PANEL		
C	11-28-11	UPDATE SUPPORT LOCATIONS AND DIMENSIONS	GSJ	